


NOTE: HYDRANT VALVE IS TO BE MARKED W/ A BLUE REFLECTIVE MARKER & A SIGN W/ WHITE LETTERING, $\frac{3}{8}$ " STROKE, & 3" LETTERS W/ THE WORD "DRAFT" & MOUNTED ON A SINGLE FIRE PROOF/ FIRE RETARDANT POST. THE WORD "DRAFT" MAY BE MOUNTED EITHER HORIZONTALLY OR VERTICALLY.
 DRAFT SIGN & REFLECTIVE MARKER TO FACE DRIVE AISLE



NOTE: FIRE HYDRANT TO BE PAINTED RED AND SIGNAGE POSTED ON IT TO READ "DRAFT" IN MINIMUM 1" HIGH WHITE LETTERS.

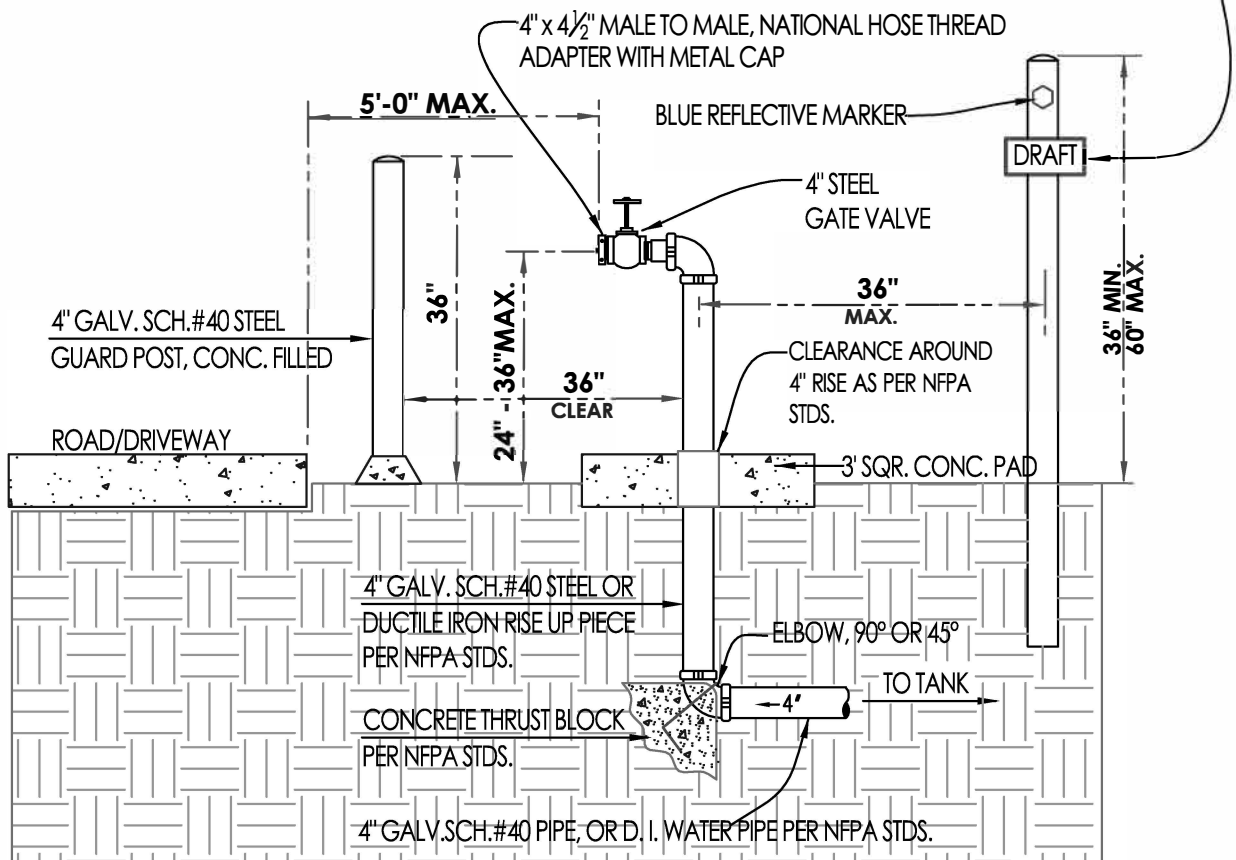

- ### DRAFT HYDRANT FROM TANK
1. All Draft Hydrants shall be "wet"
 2. Show location of fire hydrant connection, to be within 50' min. - 150' max. from residence.
 3. Hydrant shall not be obstructed by vegetation or structures
 4. Water Storage required for Domestic purposes is in addition to fire protection reserve. All domestic piping & valves shall be installed above fire water reserve level.
 5. A blue dot reflector shall be located adjacent to hydrant
 6. Fire hydrant location shall be located within 5' of driveway. Hydrant shall not block ingress/egress to/from residence. Provide turnout at that location if needed.

FIRE SAFETY STANDARDS	
DATE:	JULY 27, 2017
SCALE:	NO SCALE
STANDARD NO.	2B
REVISION DATE:	

